

3-70


BOOK 5 PAGE 10
Dec 31 2 43 PM '84
REGISTER OF DEEDS
DURHAM COUNTY, NC

FLOOR PLAN
ELECTRICAL PLAN
MECHANICAL PLAN
PLUMBING PLAN
UNIT 310


THE EXECUTIVE PARK
MAY 24, RESEARCH TRIANGLE PARK
DURHAM, NORTH CAROLINA

BROCKWELL/HOKE
ARCHITECTS, INC.
DURHAM, NORTH CAROLINA

DATE: 12/12/83
DESIGNED BY: SHB
CHECKED BY: SHB
APPROVED BY: SHB
JOB NO.
SHEET NO. A-17 OF 18

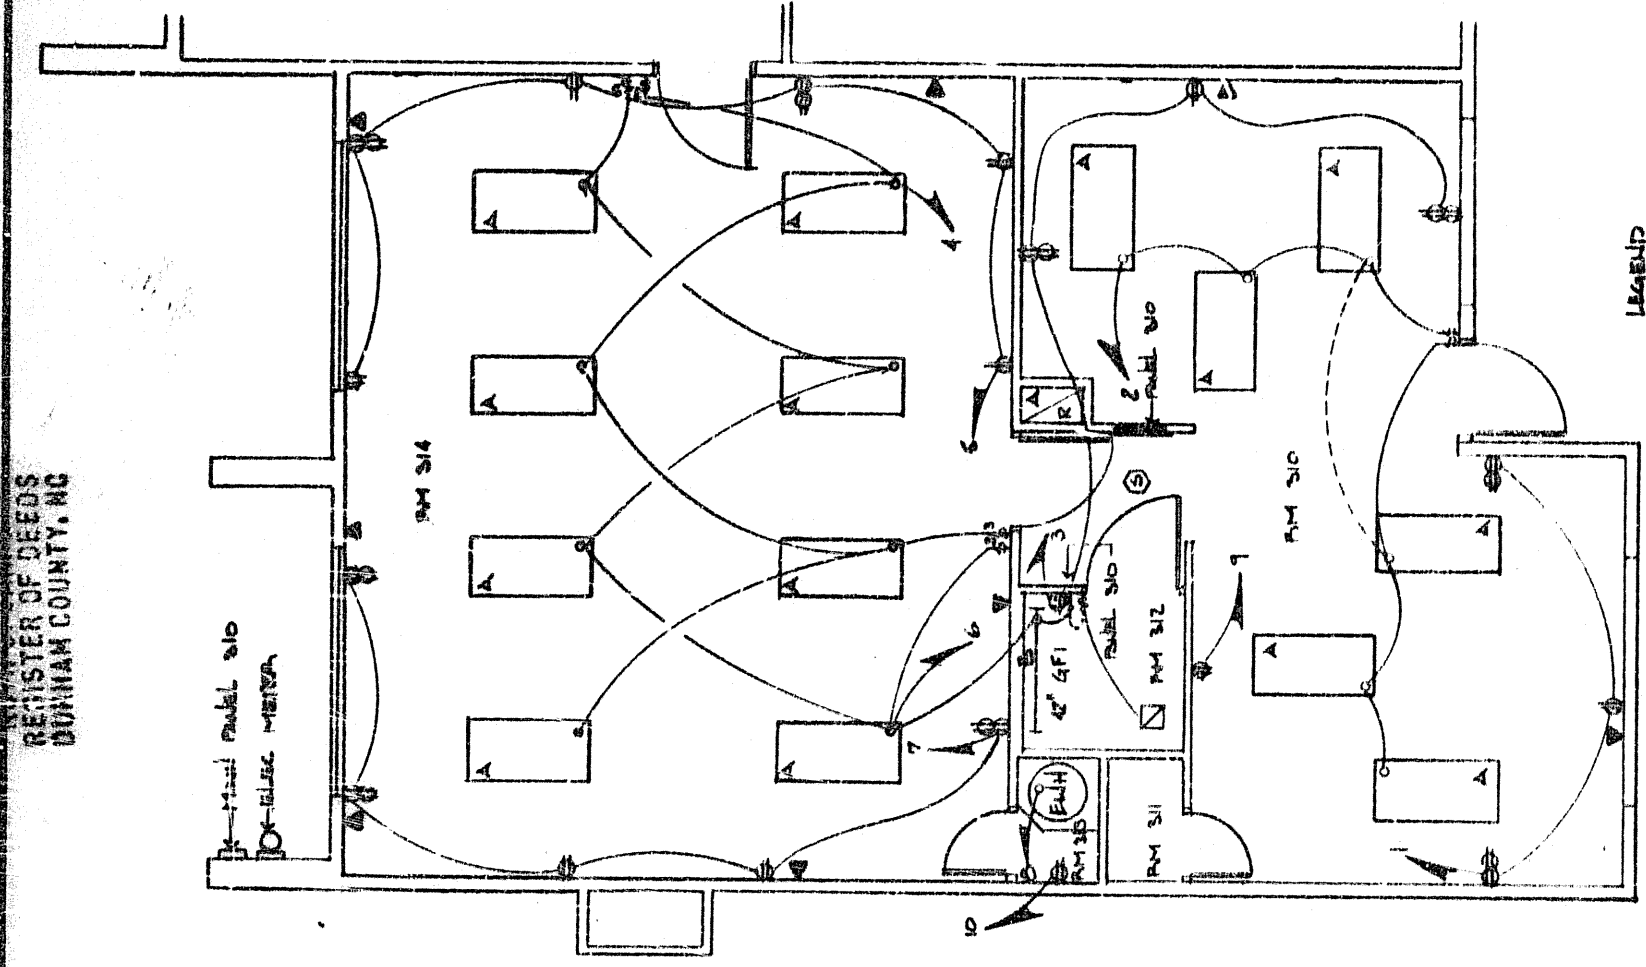

1703 FLOOR PLAN
1/4" = 1'-0"

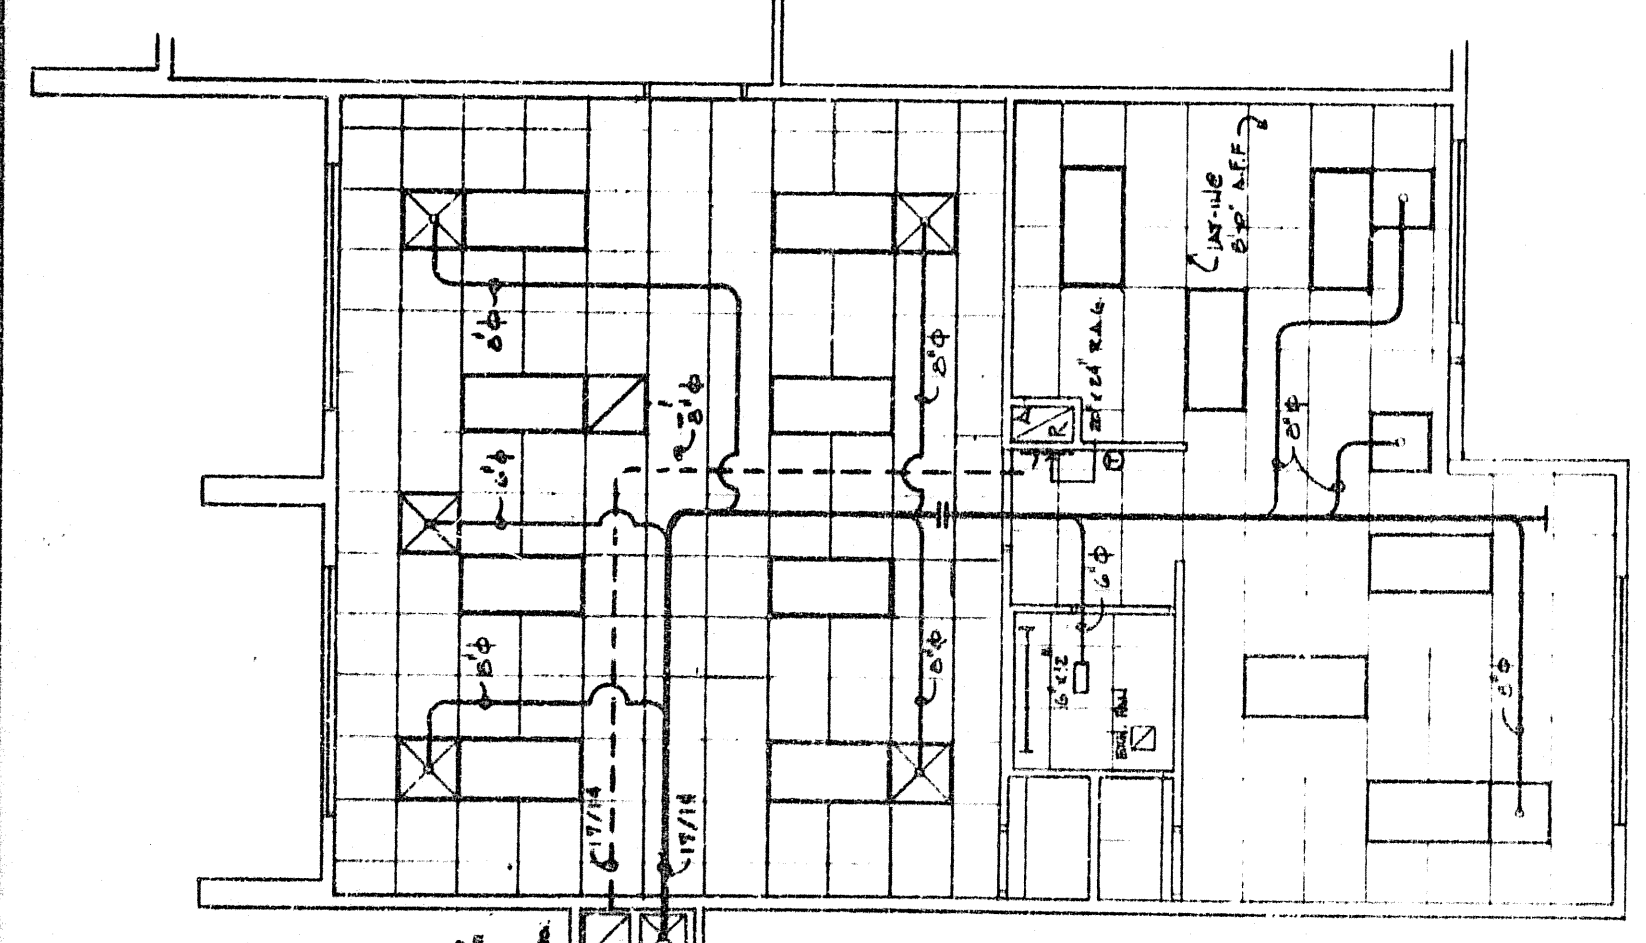

1704 PLUMBING PLAN
1/4" = 1'-0"

HEAT PUMP - 50 AMP, 2 P.
2 P.O. 400, 1/2 TON
SPLIT SYSTEM, 1/2 TON
2 - POLE SPACE


PANEL SCHEDULE	MAIN PANEL 310	SURFACE MOUNTED
1	200 AMP MAINS	
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		

NOTE: 1. Panel suitable for service entrance.
2. Breakers suitable for overhead ground fault.

PANEL SCHEDULE	PANEL 310	RECESS MOUNTED
1	200 AMP MAINS	
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		

NOTE: All breakers shall be 20 AMP, single pole.

PANEL SCHEDULE	PANEL 310	RECESS MOUNTED
1	200 AMP MAINS	
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		

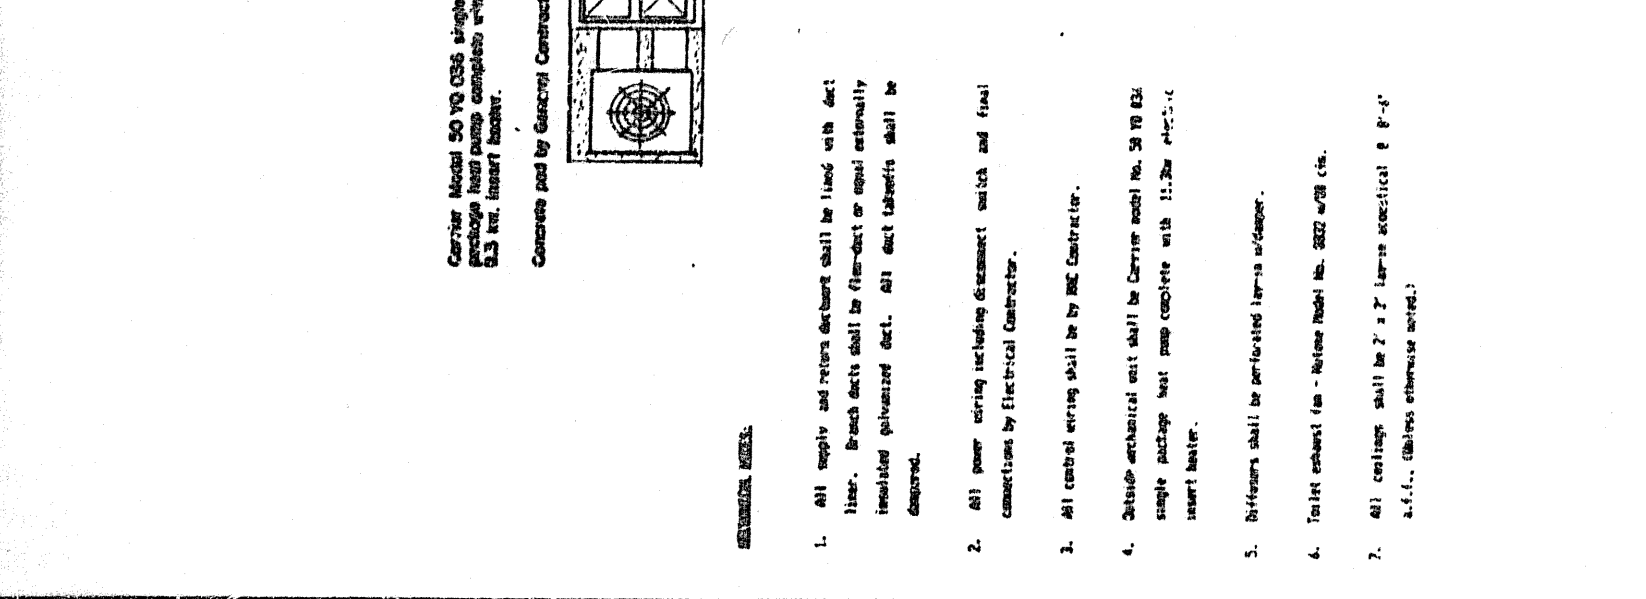

1702 ELECTRICAL PLAN
1/4" = 1'-0"

NOTE: 1. Panel suitable for service entrance.
2. Breakers suitable for overhead ground fault.

PANEL SCHEDULE	MAIN PANEL 310	SURFACE MOUNTED
1	200 AMP MAINS	
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		

NOTE: All breakers shall be 20 AMP, single pole.

PANEL SCHEDULE	PANEL 310	RECESS MOUNTED
1	200 AMP MAINS	
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		